




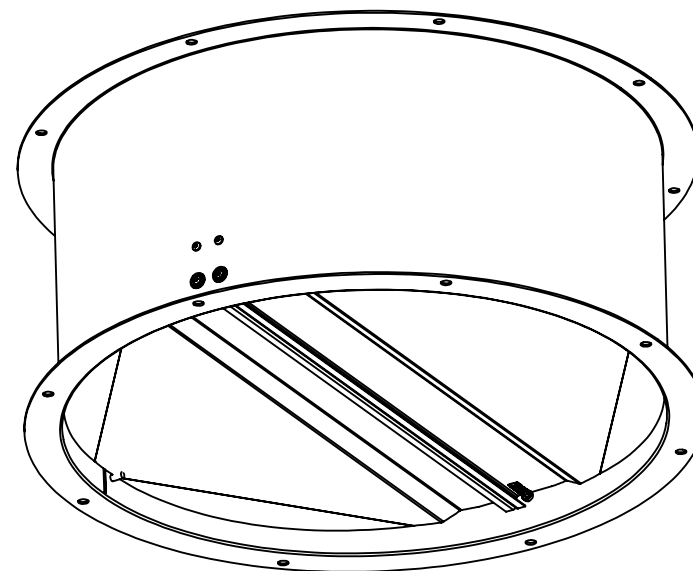

Luft / Air

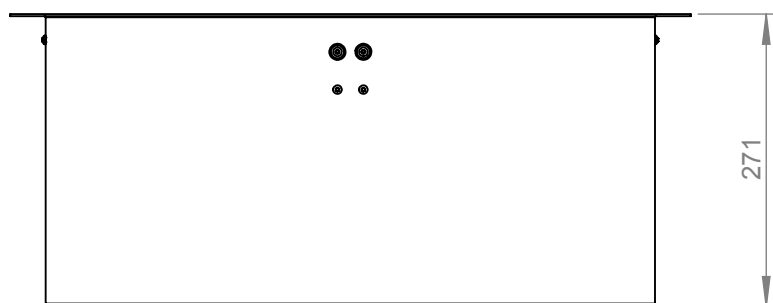

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

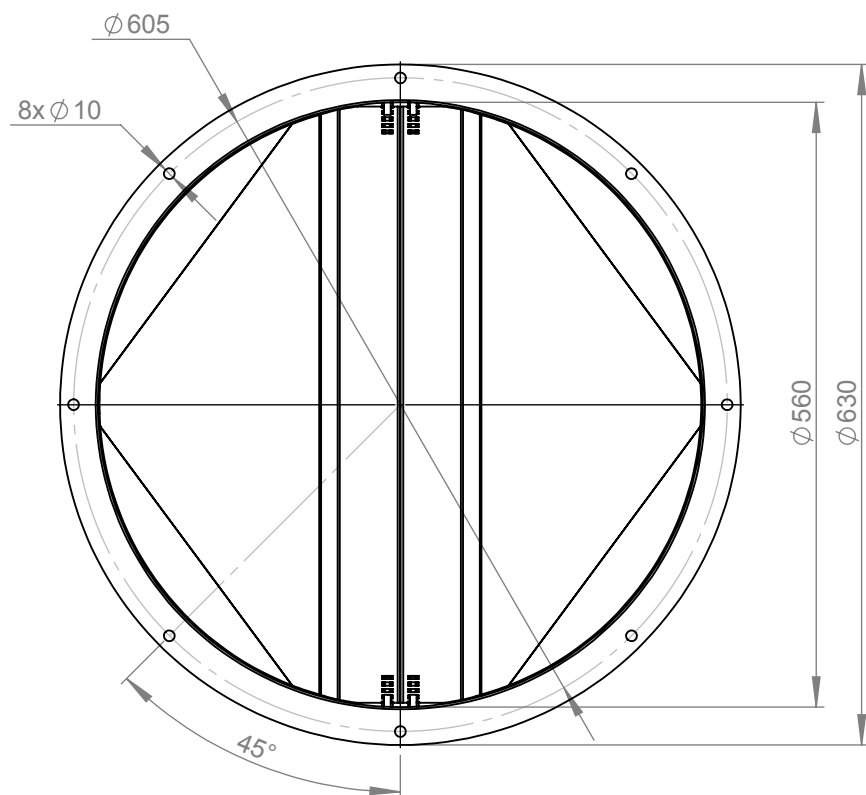

1:7 A4 mm

Protection Mark according to ISO16016 General tolerances DIN ISO 2768-c

Created h.sachsenheimer 16.07.2019
Drawn h.sachsenheimer 16.07.2019
Released h.sachsenheimer 10.12.2019
Disabled

DVK56010

152898 00