

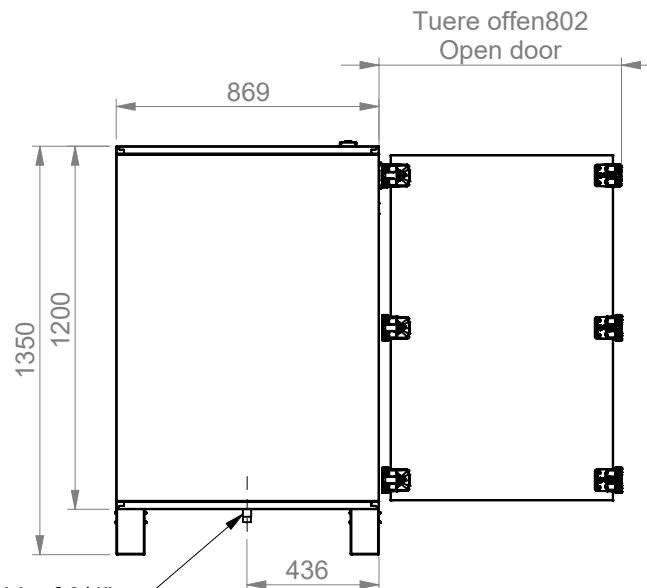


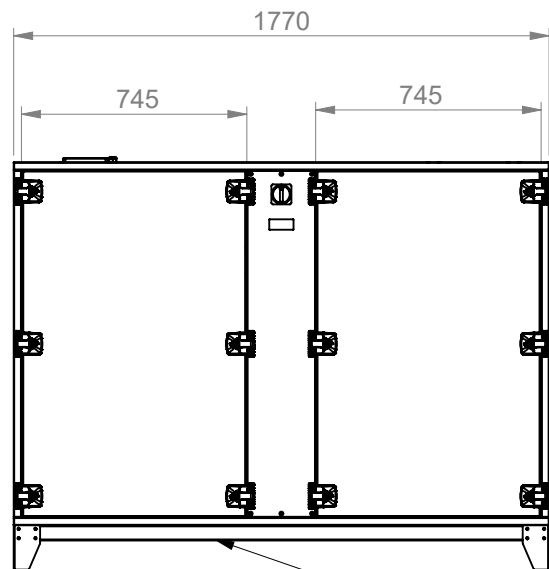

Kondensatablauf 3/4"
Aussengewinde
Drain 3/4" male thread

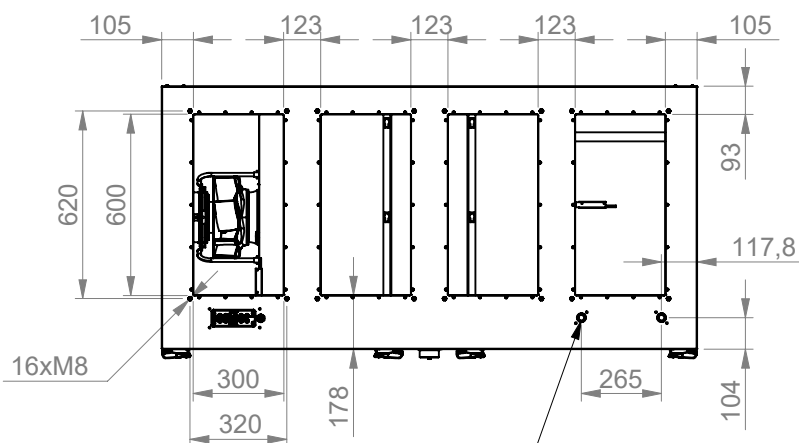

Anschluss 1/2"
Innengewinde
Connection 1/2"
female screw thread

Kanal/Duct
600x300
Kanalrahmen/
Duct Frame
PS20

Fortluft / Exhaust Air

Aussenluft / Fresh Air

Abluft / Extract Air

Zuluft / Supply Air

100662



Protection Mark
according to ISO16016

1:25 A4 mm

General tolerances
DIN ISO 2768-c

ETAK2000VWOJR

Created I.benk

24.03.2025

Drawn I.benk

24.03.2025

Released a.ganea

28.04.2025

175227 00

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

Disabled