




ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

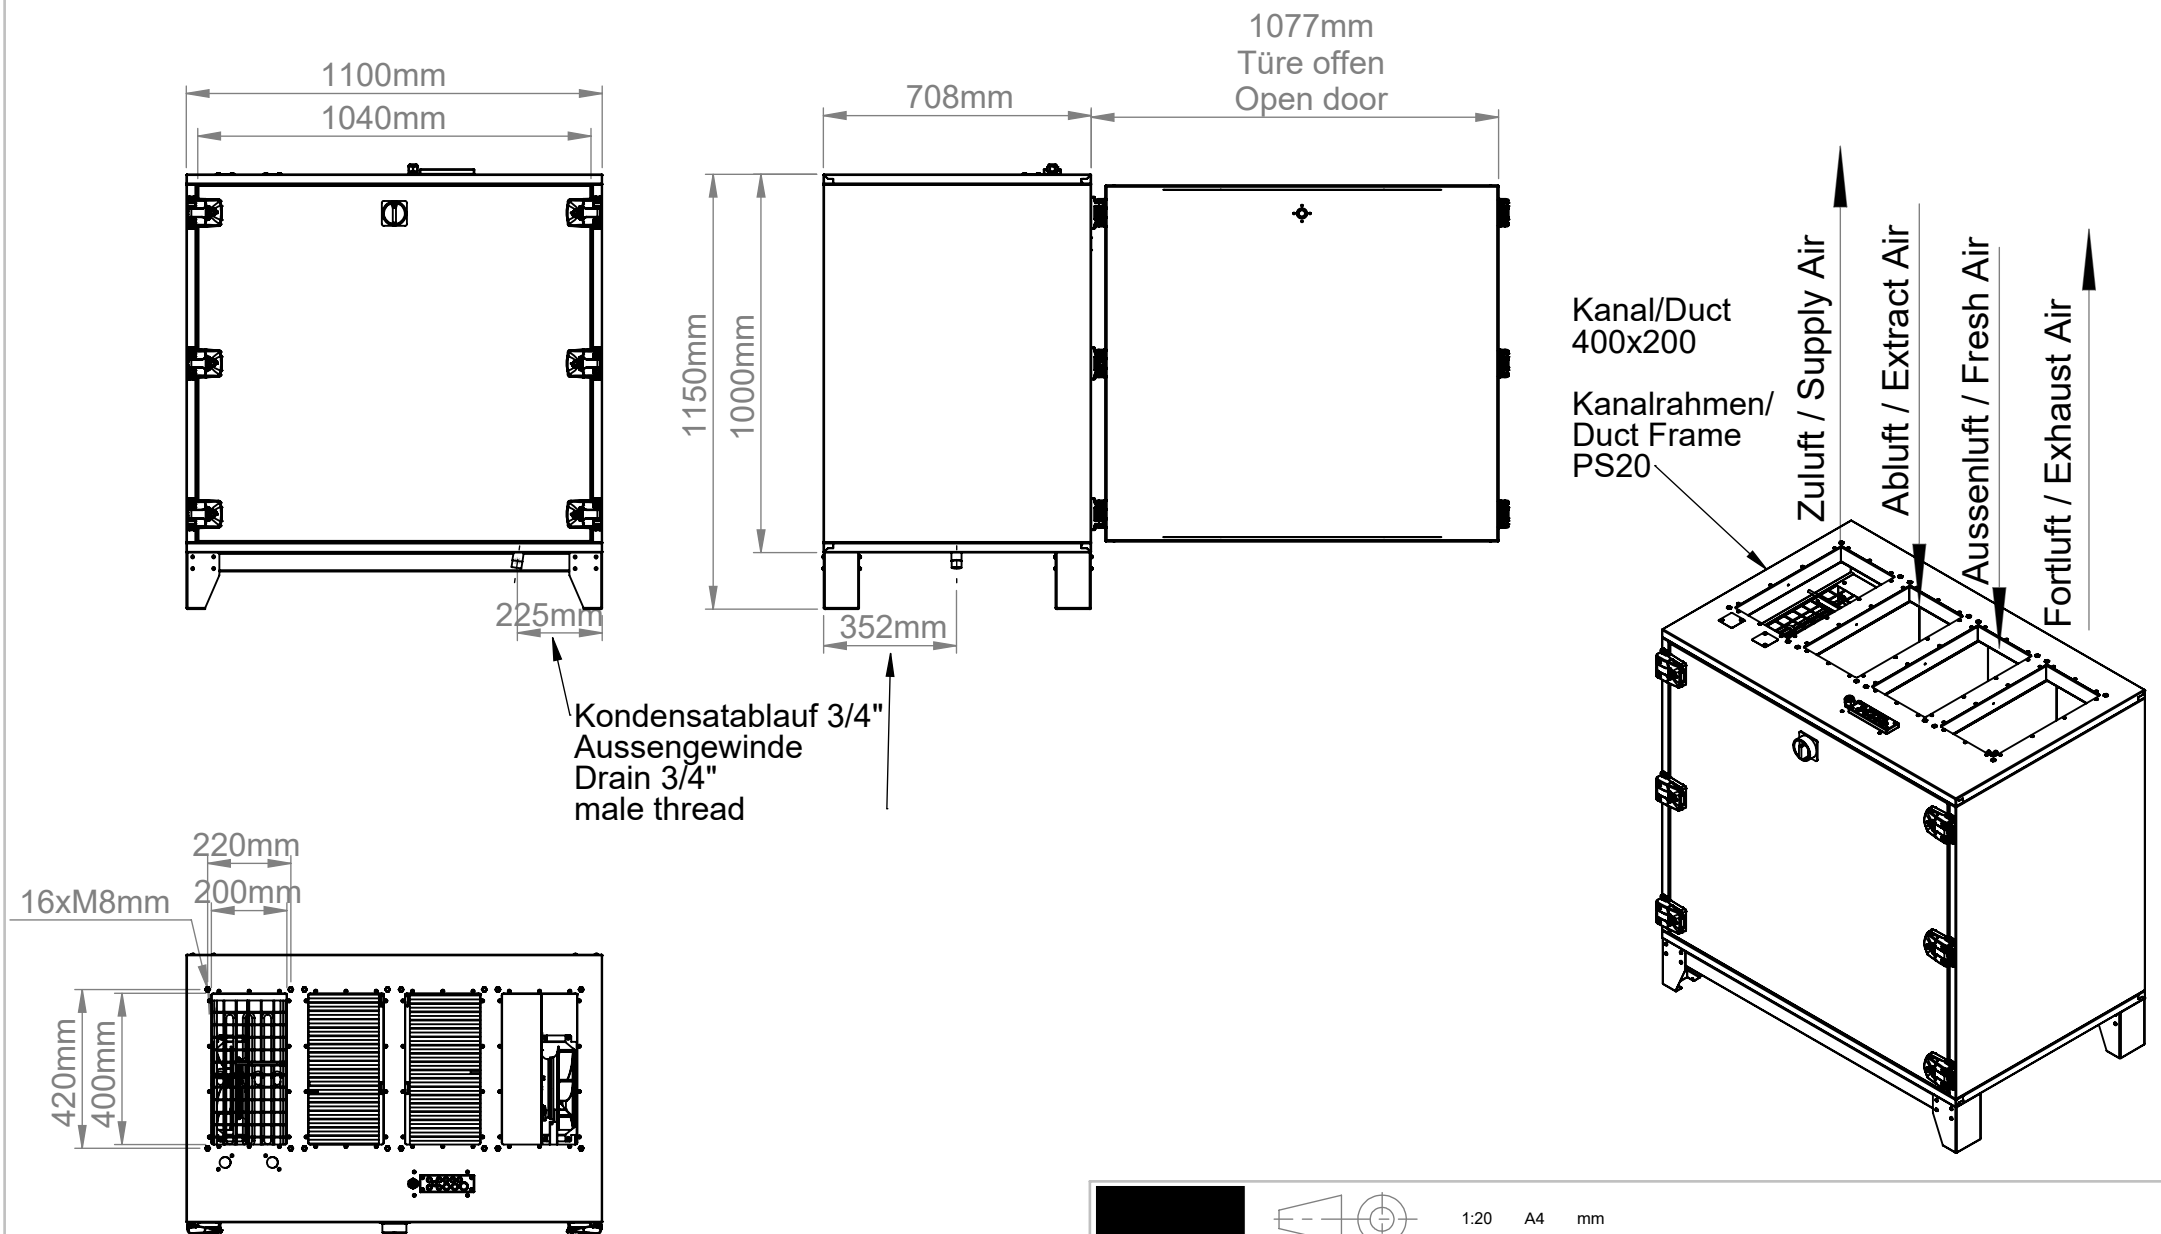

Protection Mark
according to ISO16016

Created I.benk
Drawn I.benk
Released I.benk
Disabled

1:20 A4 mm

General tolerances
DIN ISO 2768-c

26.10.2022
26.10.2022
31.10.2022

ETAK700VEOJL

165360 00