
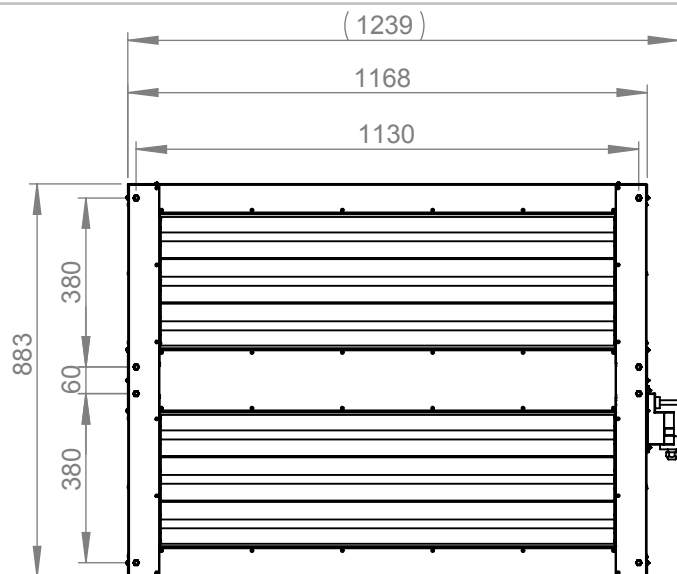


Außenluft / Fresh Air

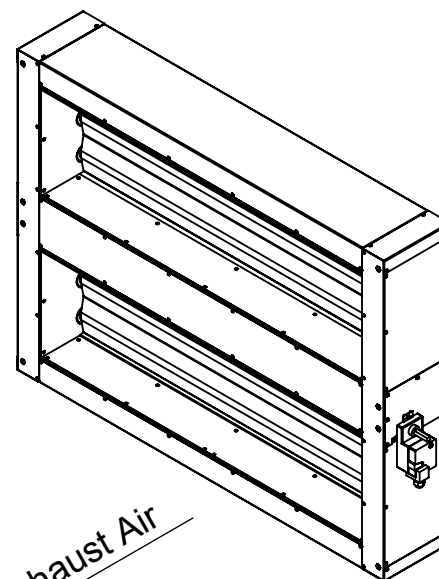

Fortluft / Exhaust Air

Duct connection	1100 x 350
Flange	P 30

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg



Protection Mark
according to ISO 16016

1:17 A4 mm

General tolerances
DIN ISO 2768-c

Created a.ganea
Drawn a.ganea
Released a.ganea
Disabled

28.03.2018
28.03.2018
04.06.2024

MAKR4200V02+

145596 00