

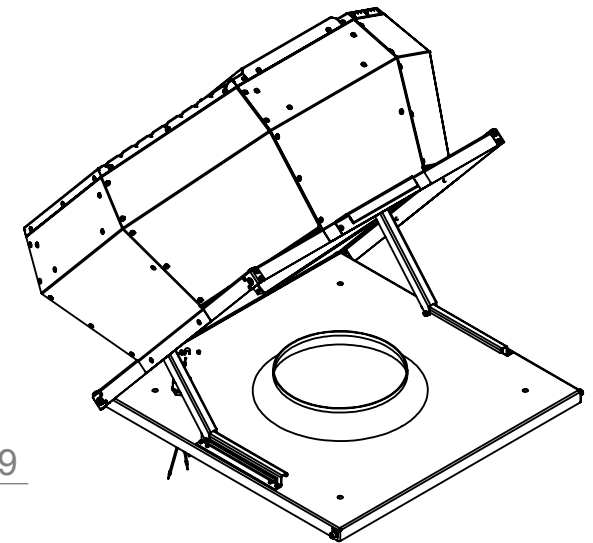


Cable outlet

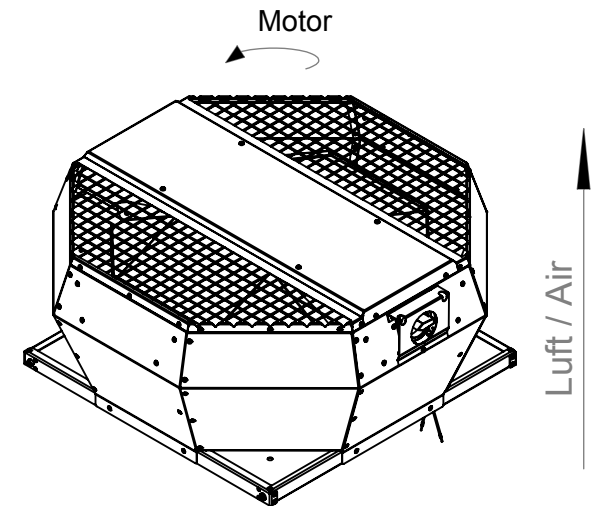

ruck Ventilatoren  
Max-Planck-Str. 5  
D-97944 Boxberg

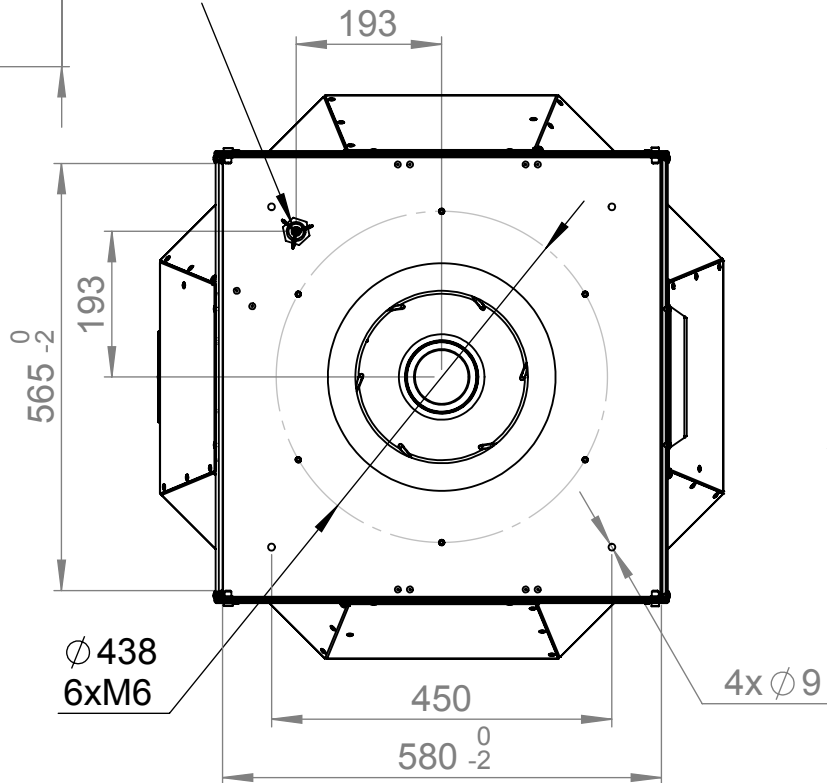

Protection Mark  
according to ISO16016

Drawn: a.ganea  
Created: a.ganea  
Changed:

1:10 A4 mm

General tolerances  
DIN ISO 2768-c

DVA355E4P31

139320 00